





CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

Exterior Strobe Detail (with STI NEMA 4x Stopper Dome)

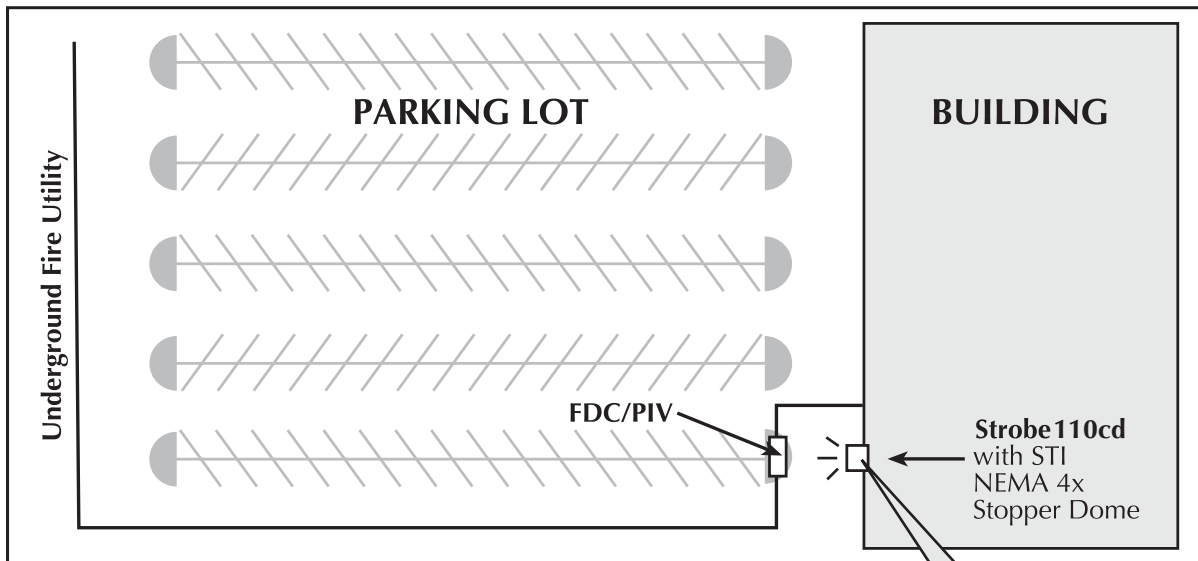

TOP VIEW

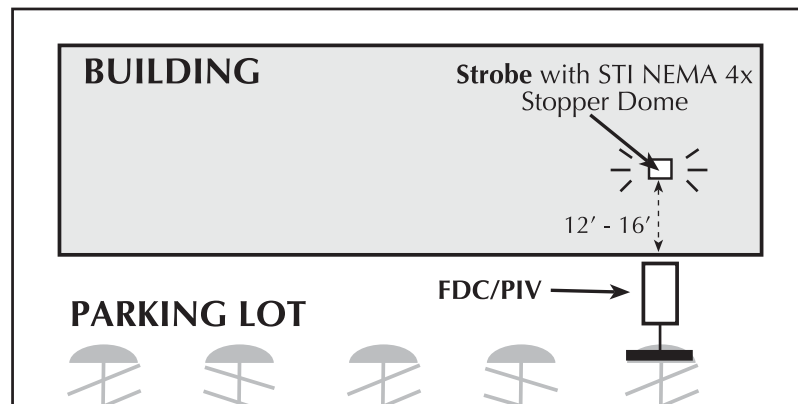

SIDE VIEW



STROBE WITH STOPPER DOME

Strobe Specifications

1. Model STI-1229
2. Install at a height between 12 - 16 feet above finished grade
3. Strobe shall only be activated upon water flow.
4. The strobe with stopper dome shall be located to create a perpendicular angle with the FDC/PIV
5. Strobe shall be a minimum of 110cd